

पत्रांक.....1145...../

दिनांक 24/4/2021...../

प्रेषक,

कार्यपालक अभियंता,  
लोक स्वास्थ्य प्रमंडल,  
औरंगाबाद।

सेवा में,

प्रबंधक  
विवेकानन्द मिशन स्कूल  
विलेय बिहार, दाउदनगर  
औरंगाबाद।

**विषय:-** जल एवं स्वच्छता से संबंधित प्रमाण पत्र निर्गत करने के संबंध में।

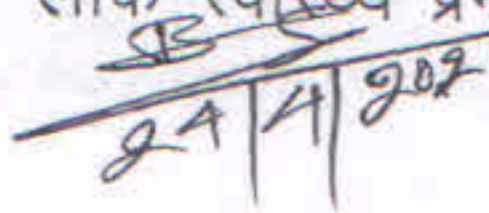
**प्रसंग:-** आपका पत्रांक—M/VMS/PHD/Lett/170/2021 दिनांक—24.04.2021  
महाशय,

उपर्युक्त विषयक प्रासंगिक पत्र के माध्यम से मांग की गयी प्रतिवेदन के संबंध में सूचित करना है कि स्कूल कैम्पस के अन्दर निर्मित जल श्रोत का जल एवं स्वच्छता बच्चों एवं स्टाफ के लिए लाभप्रद है।

सादर सूचनार्थ समर्पित।

विश्वासभाजन

 24/04/2021

कार्यपालक अभियंता,  
लोक स्वास्थ्य प्रमंडल, औरंगाबाद।  
 24/4/2021

  
**PRINCIPAL**  
Vivekanand Mission School  
Biley Vihar, Daudnagar  
Distt.-Aurangabad (Bihar)

  
**Manager**  
Vivekanand Mission School  
Biley Vihar  
Daudnagar (Aurangabad) Bihar



**Government of Bihar**  
**Public Health Engineering Department**  
**Water Quality Testing Report**

District Name:  
Aurangabad

Sample collected by- Vivekanand Mission School personal

Sample received in lab -26 /09 / 2020

SL. No.	Block	Location of Source	Parameters tested												
			pH	Turbidity	Total hardness	Calcium	Magnesium	Chloride	Alkalinity	Iron	Nitrate	Sulphate	Fluoride	Arsenic	Total Coll
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
1	Daudnagar	Vivekanand Mission School Biley Vihar Daudnagar(Aurangabad) (Hand pump in compound)	-	2	182	49.6	14	50	228	0.09	8.10	16	0.55	BDL	< 1.1
2	Daudnagar	Vivekanand Mission School Biley Vihar Daudnagar(Aurangabad) (Hand pump beside school building)	-	2	200	56	14	52	228	0.1	17.4	14	0.46	BDL	< 1.1
3	Daudnagar	Vivekanand Mission School Biley Vihar Daudnagar(Aurangabad) (Submersible moter tanki north side of school building)	-	1	204	56	15	46	248	0.06	4.32	16	0.48	BDL	< 1.1
4	Daudnagar	Vivekanand Mission School Biley Vihar Daudnagar(Aurangabad) (Submersible moter tanki south side of school building)	-	1	200	56.8	14	20	252	0.08	2.40	8	0.33	BDL	< 1.1
Desirable limit .			6.5-8.5	1	200	75	30	250	200	0.3 mg/l	45 mg/l	200	1.0	0.01 mg/l	-
Maximum Permissible limit in absence of alternate source			NR	5 NTU	600 mg/l	200 mg/l	100 mg/l	1000 mg/l	600 mg/l	1 mg/l	NR	400 mg/l	1.5 mg/l	NR	-

Memo NO.- 2672 / Aurangabad, Dated- 03/10/2020

Copy to Manager Vivekanand Mission School Biley vihar Daudnagar Aurangabad to inform regarding reference to his letter No.--MVMS/Ex-Eng/Wat Test /54/20 Dated- 25/ 09 / 2020

*Alex*  
30.9.2020

Lab Assistant

*Dr. 30.09.2020*  
Chemist

*Dr. 30/09/2020*

Executive Engineer  
P.H.Division, Aurangabad

*Dr. Singh*

Manager

Vivekanand Mission School  
Biley Vihar, Daudnagar  
Aurangabad (Aurangabad) Bihar

*Dr. Singh*

**PRINCIPAL**  
Vivekanand Mission School  
Biley Vihar, Daudnagar  
Aurangabad (Bihar)